

## Horsepower Bulletin

### Implement a Simple, Cost-effective Policy for Industrial Induction Motor Repair or Replacement\*

Advanced Energy's independent motor test lab's Horsepower Bulletin can assist you in:

#### Choosing Between Repairing or Replacing a Motor Before Failure

- Determine your horsepower breakpoint [above which to repair, below which to replace].
- Communicate with purchasing officers and other signatories about motor economics.

#### Getting Replacement Motors

- Establish a motor inventory.
- Create a motor specification.
- Develop a relationship with motor suppliers.

#### Working with Repair Shops to Maintain Quality

- Select and audit quality shops.
- Specify repair criteria.
- Reduce emergency motor repairs.

Annual operating cost of a motor is often many times the initial cost. Consequently, a motor replacement policy based on purchase price and operating cost can improve your company's cash flow by reducing annual operating and maintenance costs.

First, determine your current policy and discuss the changes recommended here with all affected parties. This will help refine and coordinate implementation of this policy. With this policy in place, you can achieve better economic choices for your facility.

#### A COMMON-SENSE APPROACH

A motor repair or replacement policy that is the most likely to be followed should be simple, clear and not require a lot of additional work. Here are the basics for a common-sense approach to motor management:

- Conduct a motor inventory and survey critical motors.
- Ensure that motor purchasing procedures account for life-cycle costs.
- Make the right new motors available.
- Identify your preferred motor service providers, and communicate expectations.

This bulletin provides information about each of these topics with websites and other references listed throughout for additional assistance in developing your own common-sense motor policy.

*Special cases not covered: non-NEMA1, multi-speed, DC, 900RPM, NEMA Designs C & D, and special purpose motors.*

#### CONDUCT A MOTOR INVENTORY AND SURVEY CRITICAL MOTORS

See Advanced Energy's Motor Survey How-To-Guide for more information and instruction on how to complete these critical first steps to a sound motor management policy by visiting <http://www.advancedenergy.org/mad/training.php>



\*For AC Induction Motors, NEMA Designs A & B, 1Hp to 500Hp, 1200, 1800 and 3600 RPM

*Special cases not covered: non-NEMA1, multi-speed, DC, 900RPM, NEMA Designs C & D, and special purpose motors.*

## ENSURE THAT MOTOR PURCHASING PROCEDURES ACCOUNT FOR LIFE-CYCLE COSTS

It is important to understand how much your motors cost to operate over their entire life, called the life-cycle cost. By understanding how these costs are incurred, you will make better economical decisions about motor repair or replacement.

### Operating Versus Life-cycle Costs

The first thing most people consider in any type of purchase is the initial cost, which is the amount paid up front just to take ownership. For a 75Hp, 1,800RPM motor that amount is just over \$4,000.

If that motor operates 50 percent of the year (4,000 hours is two shifts, five days per week) and has a nameplate efficiency of 94.1 percent, at the current national average of \$0.0702 per kWh (EIA), the motor will cost more than \$16,000 to operate each year — that is four times more than the initial cost in the first year, and electricity costs are only expected to increase in the future.

Now consider the cost over the entire lifetime of these two investment scenarios. For the electric motor, only about three percent of the life-cycle costs of the motor are due to the initial investment. 97 percent of the life-cycle costs are operating costs. See Table 1.

**Table 1: Investment Comparison Summary**

	75Hp Electric Motor	Car
Initial Cost	\$4,249	\$17,000
Annual Usage	4,000 hours	15,000 miles
Efficiency	94.1%	30 mpg
Fuel Costs	\$0.0702/kWh	\$3.509/gallon
Lifetime	10 Years	7 Years
Annual Operating Cost	\$16,695	\$1,755
Life-cycle Cost	\$171,199	\$29,282
Operating Cost as a percent of Life-cycle Costs	97.0%	41.9%

By comparison, the car's initial cost is more than 52 percent and fuel costs a mere 42 percent of the life-cycle costs.

Purchase price should not be your only consideration when making your decision to purchase or repair. In purchasing electric motors, consider the efficiency impact, as it will greatly affect the life-cycle cost, which is the prime driver of motor economics.

### Using Life-cycle Costs to Make Your Decision

Because operating costs account for the largest portion of a motor's life-cycle costs, it is important to consider the potential for savings between two options, such as two new motors or repair versus replacement in comparison to the initial investment. The incremental cost of selecting a particular option, such as purchasing a new NEMA Premium® motor, divided by the annual savings from selecting that option over a competing option, such as repairing an old motor, is called the payback period.

The payback equation for motors can be rearranged to show when costs break even at a given payback period and electric rate. When plotted over time, this graph is called the horsepower breakpoint curve [as shown in Graph 1]. At given annual operating hours, the curve produces a facility's horsepower breakpoint, the horsepower rating above which motors should be repaired, and below which motors should be replaced with a new motor. This concept, as well as the curve's dependence on each facility's operating condition, is illustrated in Graph 1.

The following information is needed to produce the most accurate curve for your facility:

### 1. Average Electric Rate [\$ per kWh]

Add your electric bills [energy, demand and fees] for the most recent 12 months. Add the total energy [kWh] used during the same period and divide the total cost by the total kWh to find the average electric rate. Contact your electric utility company for assistance, if needed.

### 2. Maximum Acceptable Payback Period

Many companies require a payback period of less than two years; however, some allow as much as 10 years for energy efficiency or reliability projects. Check your company's payback requirements. Life-cycle costs should also be considered for how much money will be lost by not replacing with a NEMA Premium motor.

### 3. Motor Supplier Discount

You will be asked to estimate a discount applied to new motor purchases by your motor supplier since many companies have negotiated lower costs than motor list price. Contact your purchasing department or your motor supplier for assistance.

### 4. Average Motor Load


This is the average load on the motor as a percent of the rated [nameplate] load. The average load is often assumed to be 75 percent, but may range from less than 25 percent to 125 percent. Since this varies by motor it may be necessary to check amp readings and compare them to the nameplate amps, or use readings from the motor's history record. For a more accurate watt measurement, see our [Motor Survey](#).

### Example

A corporate engineer decides to find the horsepower breakpoint for two facilities, one in North Carolina with an average electric rate of \$0.04 per kWh, and one in New Hampshire with an average electric rate of \$0.12 per kWh. These facilities operate three shifts, five days a week [6,200 hours]. The company requires a two-year payback. A corporate-wide contract with a motor supplier that provides a 40-percent discount from list price is in place, and the engineer determines the average motor load to be 75 percent.

The engineer produced the curves in Graph 1 showing that in North Carolina, 1,800RPM motors 25Hp and lower for open drip proof [ODP] enclosures and 10Hp and lower totally-enclosed, fan-cooled [TEFC] motors should be replaced with NEMA Premium motors upon failure. In New Hampshire, replace 1,800RPM motors 250Hp and lower for ODP enclosures and 60Hp and lower TEFC motors with NEMA Premium motors upon failure.

Graph 1: Breakpoint for Replacing a Failed Motor with a NEMA Premium® Motor

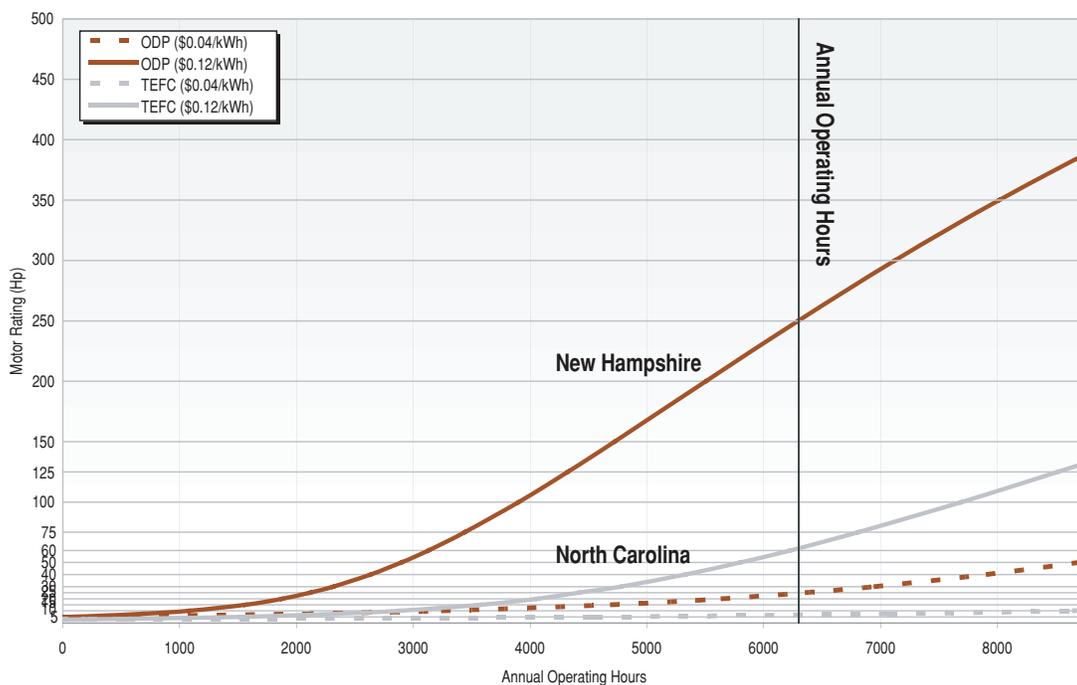

## MAKE THE RIGHT NEW MOTORS AVAILABLE

Advanced planning will reduce stress and panic during motor problems because the right motor will be available for each application when needed. Planning and creating a motor inventory and motor specification will ensure availability of motors.

### Establish an Inventory System

An established inventory system systematically increases the efficiency of motor populations, which will cut costs by avoiding emergency motor repairs and statistically increasing the time between failure.

### Take Care of Critical Motors First

If the cost of downtime per hour exceeds twice the purchase price for a new motor in any particular application, a new motor should be purchased and installed at the earliest scheduled downtime. These motors should be replaced on a regular basis [i.e. every two to five years] to prevent unscheduled shutdowns, and a dedicated new motor should be kept as a spare in inventory. Where possible, build in-line redundancy into your most critical processes.

### Keep Inventory and Records


Knowing which spares are available and how to locate them quickly and easily will save a good deal of time during an unplanned motor downtime. Also, keeping records will identify problematic motors or applications. Tools such as MotorMaster+, available for free through the U.S. Department of Energy, provide a management system for these motor records. One person should be responsible for maintaining these records if this service is not available through your motor suppliers.

## Make Records Available to Maintenance and Purchasing Departments

Use the inventory and records [especially failure and repair history] to reveal premature failures and identify good candidates for replacement as part of the budget cycle. This will help appropriately allocate funds for accounting and maintenance, and further streamline motor replacement at the time of failure.

Once the motors that require spares are identified, this inventory list can be used to negotiate cost and availability of replacement motors with your motor supplier. Make arrangements in the following order of preference:

1. **CONSIGNED INVENTORY:** motors kept in your plant but owned by your supplier and billed when installed
2. **GUARANTEED INVENTORY DELIVERED WITHIN FOUR HOURS:** inventory maintained by supplier, and
3. **OWNED INVENTORY:** motors you purchase and store for your spares inventory.

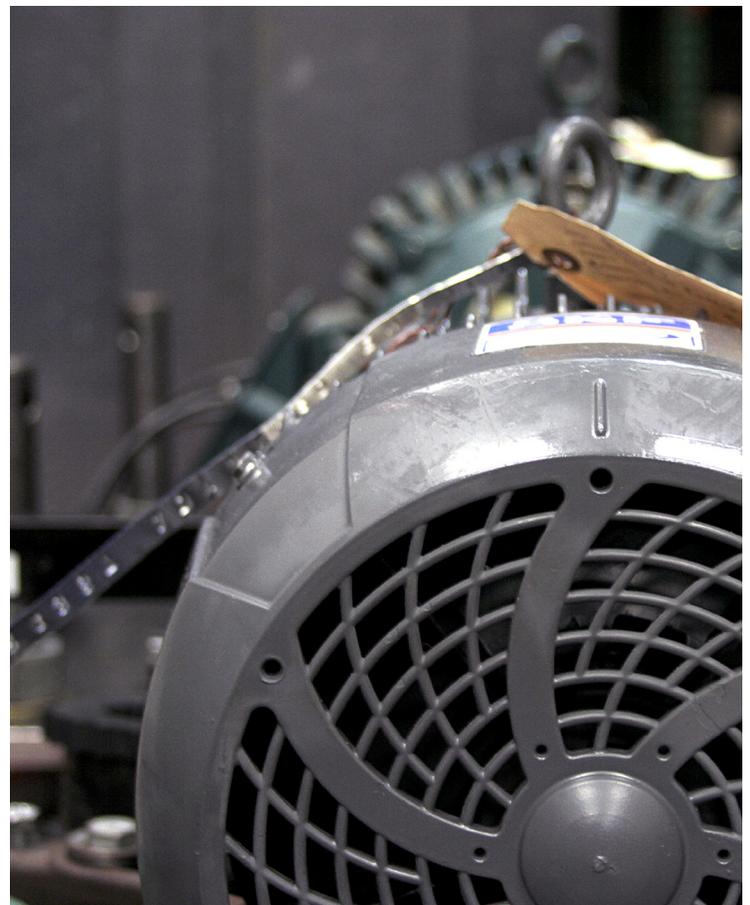

## Create a Motor Specification

Motor specifications will ease the process of purchasing a new motor. A motor specification lists basic standards for new motor purchases, and a more detailed specification addresses performance characteristics and specific applications.

As a minimum, a basic specification should include:

1. NEMA Premium motors for new motor or equipment purchases. Also, note whether IEEE841 specifications are required for motors in harsh conditions. At a minimum, motors purchased should meet the energy-efficiency standard set forth by the United States government as part of the Energy Independence and Security Act of 2007 [EISA] (see Table 2).
2. Same voltage and frequency as the plant where the motor will operate.
3. NEMA frame sizes [in feet and inches] on new equipment for future replacement flexibility.
4. Any necessary replacements for specialty motors, such as non-NEMA motors [i.e. metric, DC, etc.] in operation with NEMA Premium motors and drives.
5. Speed equal to the motor being replaced.

**Table 2. Motor Efficiencies**

Hp	NEMA Premium	Energy Efficient
1	85.5	82.5
1.5	86.5	84.0
2	86.5	-
3	89.5	86.5
5	89.5	87.5
7.5	91.7	88.5
10	91.7	89.5
15	92.4	91.0
20	93.0	91.0
25	93.6	91.7
30	93.6	92.4
40	94.1	93.0
50	94.5	93.6
60	95.0	94.1
75	95.4	94.1
100	95.4	94.5
125	95.4	95.0
150	95.8	95.0
200	96.2	95.4
250	96.2	95.4
300	96.2	95.4
350	96.2	95.4
400	96.2	95.4
450	96.2	95.8
500	96.2	95.8

*Table values are for 1800RPM TEFC motors. Efficiency values for other speeds and enclosures are available by visiting: [http://www1.eere.energy.gov/buildings/appliance\\_standards/product.aspx/productid/50](http://www1.eere.energy.gov/buildings/appliance_standards/product.aspx/productid/50)*

## Reducing the Red Tape

The capital approval process red tape surrounding the purchase of new equipment may result in continuing repairs. Many facilities have an annual maintenance budget that accounts for motor repair, but not new motor purchases. Do not let sound economic decisions be influenced by budgetary policies between departments [i.e. purchasing and maintenance]. Working with purchasing agents and other signatories using the tools provided in this bulletin at simplifies and speeds up the process.

## AUDITING YOUR MOTOR REPAIR FACILITY

- Is the facility's equipment in good condition?
- Is the facility in compliance with safety requirements, neatness and housekeeping?
- Are records and files well organized?
- Are employees knowledgeable and satisfied at work?
- Does the facility keep a variety of wire sizes and shapes in stock? [Look for half and full sizes if you have foreign motors].
- What is the test equipment purpose and frequency of use?
- Does the facility comply with the motor repair quality standards or specifications supplied?
- Check the facility's compliance with standards and procedures published by EASA\*. [Membership in EASA is a bonus].
- Does the facility have an active quality assurance program?

## MOTOR REPAIR QUALITY STANDARDS\*

### Require repair to duplicate the original motor in:

- Number of turns
- Winding design and coil configuration [lap or concentric].
- Wire cross sectional area.
- Rolling bearing size, type and specification including seals and/or shielding.

### Always replace bearings when rewinding. One-third to one-half of all motor failures involve bearing failures.

### Ask your repair facility to:

- Record core loss before and after stripping.
- Repair or replace defective laminations.
- Calibrate instruments at least annually.
- Measure and record winding resistance.
- Measure and record no-load amps and voltage during final test.
- Have a quality assurance program.
- Have and use the following equipment: ammeter, voltmeter, wattmeter, ohmmeter, megohmmeter, high potential tester.

### Ask your repair facility NOT to:

- Heat stators above 650°F.
- Sandblast the iron core.
- Knurl, peen or paint bearing fits.
- Use an open flame for stripping.
- Grind the laminations or file the slots.
- Increase the air gap.
- Increase stator winding resistance.
- Make mechanical modifications without your approval.
- Change the winding design.

### Ask if the repair facility will maintain records as part of your inventory system to help identify root causes of failures.

### Avoid rush rewinds, if possible. Speeding up certain processes [such as stator burn-out] can cause damage.

*\*From EASA Technical Note 16. Electrical Apparatus Service Association, 314-993-2220, [www.easa.com](http://www.easa.com)*

## IDENTIFY PREFERRED MOTORS SERVICE PROVIDERS

In order to make this policy work for you, several entities must be involved and aware of their role. In implementing your policy, specify one or two motor service centers you prefer and negotiate a contract with a single motor supplier to ensure the best pricing. This allows expectations to be communicated to those who are critical to the success of your motor policy.

### Ensure Quality Repairs


The repair facilities selected should be quality shops that have been researched, visited and have ensured that they have the equipment and skill to meet motor repair criteria. Since ensuring they can meet specific criteria requires specific knowledge about motor repair, look for shops that have outside certification. EASA Q. Accreditation is a new Third Party Program that follows the guidelines set for in the ANSI/EASA AR100 2010 version repair specification.

Proven Efficiency Verification [PEV] is the only motor repair certification program that requires annual before and after repair motor testing. The program also includes a site audit and inspection of equipment at least every five years. Both third party programs ensure the service center selected can repair motors to meet the undamaged performance characteristics. For more information about this program and the PEV repair facility nearest you, visit our website here <http://www.advancedenergy.org/programs/proven-efficiency-verification-for-motor-repair>. If your repair facility has not been assessed by Advanced Energy, you can evaluate it qualitatively for characteristics consistent with quality work using the guidelines provided in this bulletin.

### Build a Relationship with Motor Suppliers

Providing a supplier with the motor specification eliminates hypotheticals, allowing for an open and specific discussion about motor pricing and other services that may be beneficial [such as maintaining inventory and records]. Include in the motor specification the general criteria for all new motors, such as minimum efficiency level, NEMA frames and your facility's operating voltage and frequency.

## REPAIR OR REPLACE A MOTOR WHEN IT FAILS?

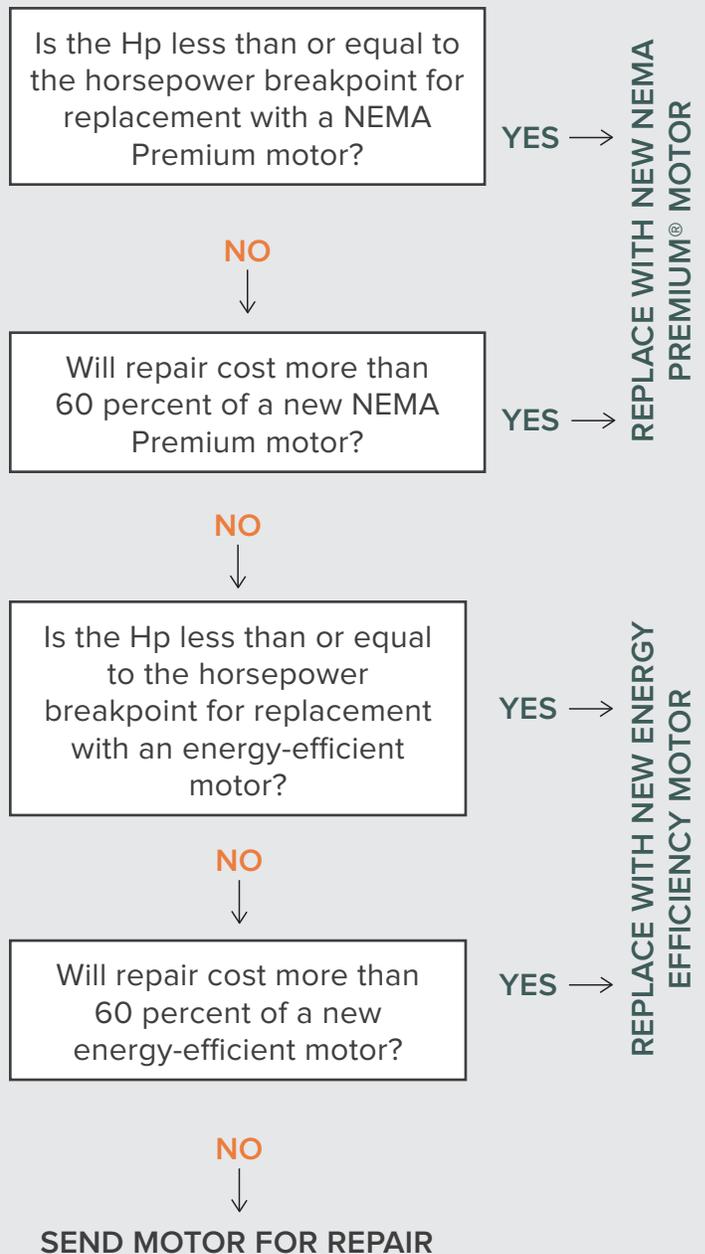

## **IMPORTANT CONSIDERATIONS FOR MOTOR REPLACEMENT**

### **Fan and Pump Applications**

If energy savings are the reason for motor replacement, the replacement motor should have a nameplate full load RPM equal to or slightly less than the motor being replaced. If this is not an option, select the motor with the lowest full load speed [but same synchronous speed] available that meets the efficiency of Table 2. This is important because a motor that runs faster will increase its power consumption as it delivers a greater process output, and can decrease the savings estimated by efficiency difference alone.

### **Sizing Replacement Motors**

Be careful when considering downsizing.

Motors may be oversized for many legitimate reasons, including high-starting loads or occasional short-duration, high-peak loads. Modern energy-efficient motor designs are efficient over a wide range of loads. This allows motors to be slightly oversized to handle less than ideal operating conditions without sacrificing efficiency, as is the case with many older motors now in service.

The material contained in this bulletin was prepared by Advanced Energy, a nonprofit corporation.

Neither Advanced Energy, its member organizations, the acknowledged individuals, nor any person acting on behalf of them: (a) makes any warranty, express or implied, with respect to the use of any information, apparatus, method or process disclosed in this publication that such use may not infringe privately owned rights; or (b) assumes any liability with respect to the use of, or for direct or consequential damages resulting from the use of, any information, apparatus, method or process disclosed in this publication; or (c) has any liability for damages that result from any negligent act or omission involved in the preparation of the material. Any implied warranty of merchantability or fitness for a particular use is specifically excluded.

### **FOR MORE INFORMATION:**

visit [www.advancedenergy.org/mad](http://www.advancedenergy.org/mad)

### **CONTACT:**

Kitt Butler  
Program Manager, Motors and Drives  
919.857.9017  
[kbutler@advancedenergy.org](mailto:kbutler@advancedenergy.org)